


Figure 3

2010 *E. coli* Results for TML-Katrine

The Ontario recreational water threshold for *E. coli* is 100 cfus per 100 ml. (cfu: colony-forming unit)

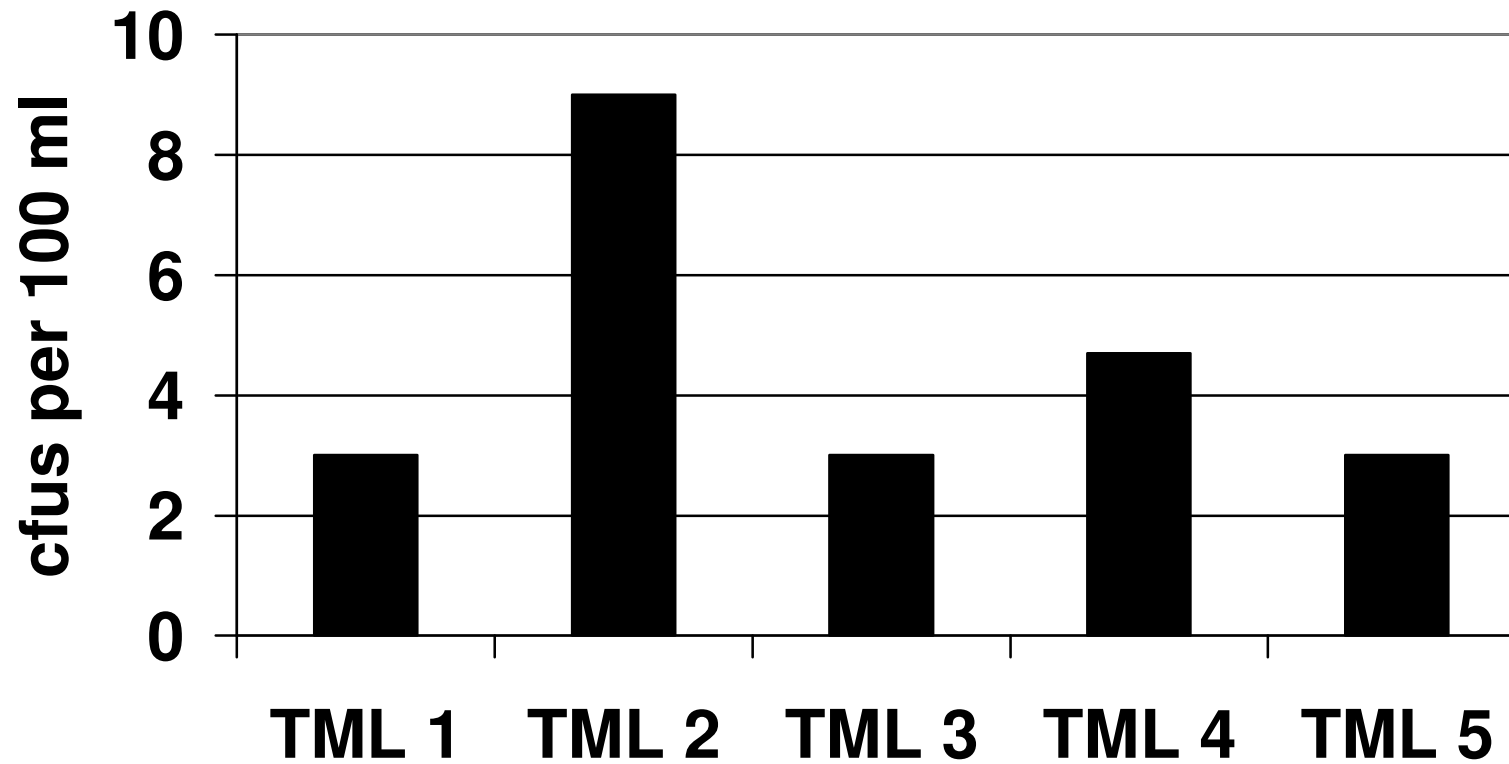

Note: since the lowest possible value is "less than 3" the numbers above represent maximum possible values.

May 27, 2011