


2009 Coliform Results for TML-Katrine

(cfu: colony-forming unit)

The Ontario recreational water threshold for coliform is 1000 cfus per 100 ml.

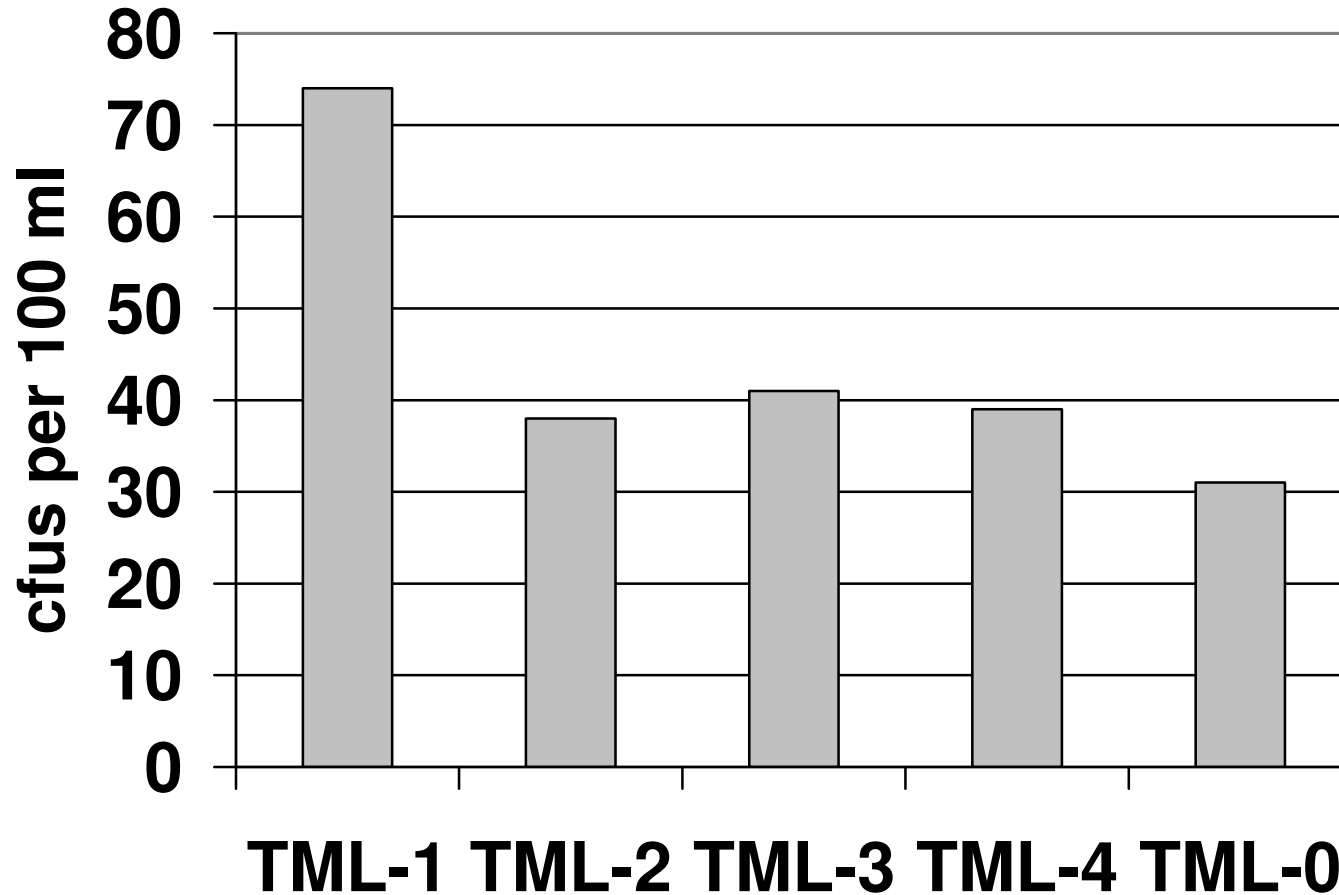

March 21, 2010