


Figure 5

Historical Average Phosphorus in TML-Katrine (Ontario Water Quality Objective is 10µg/L)

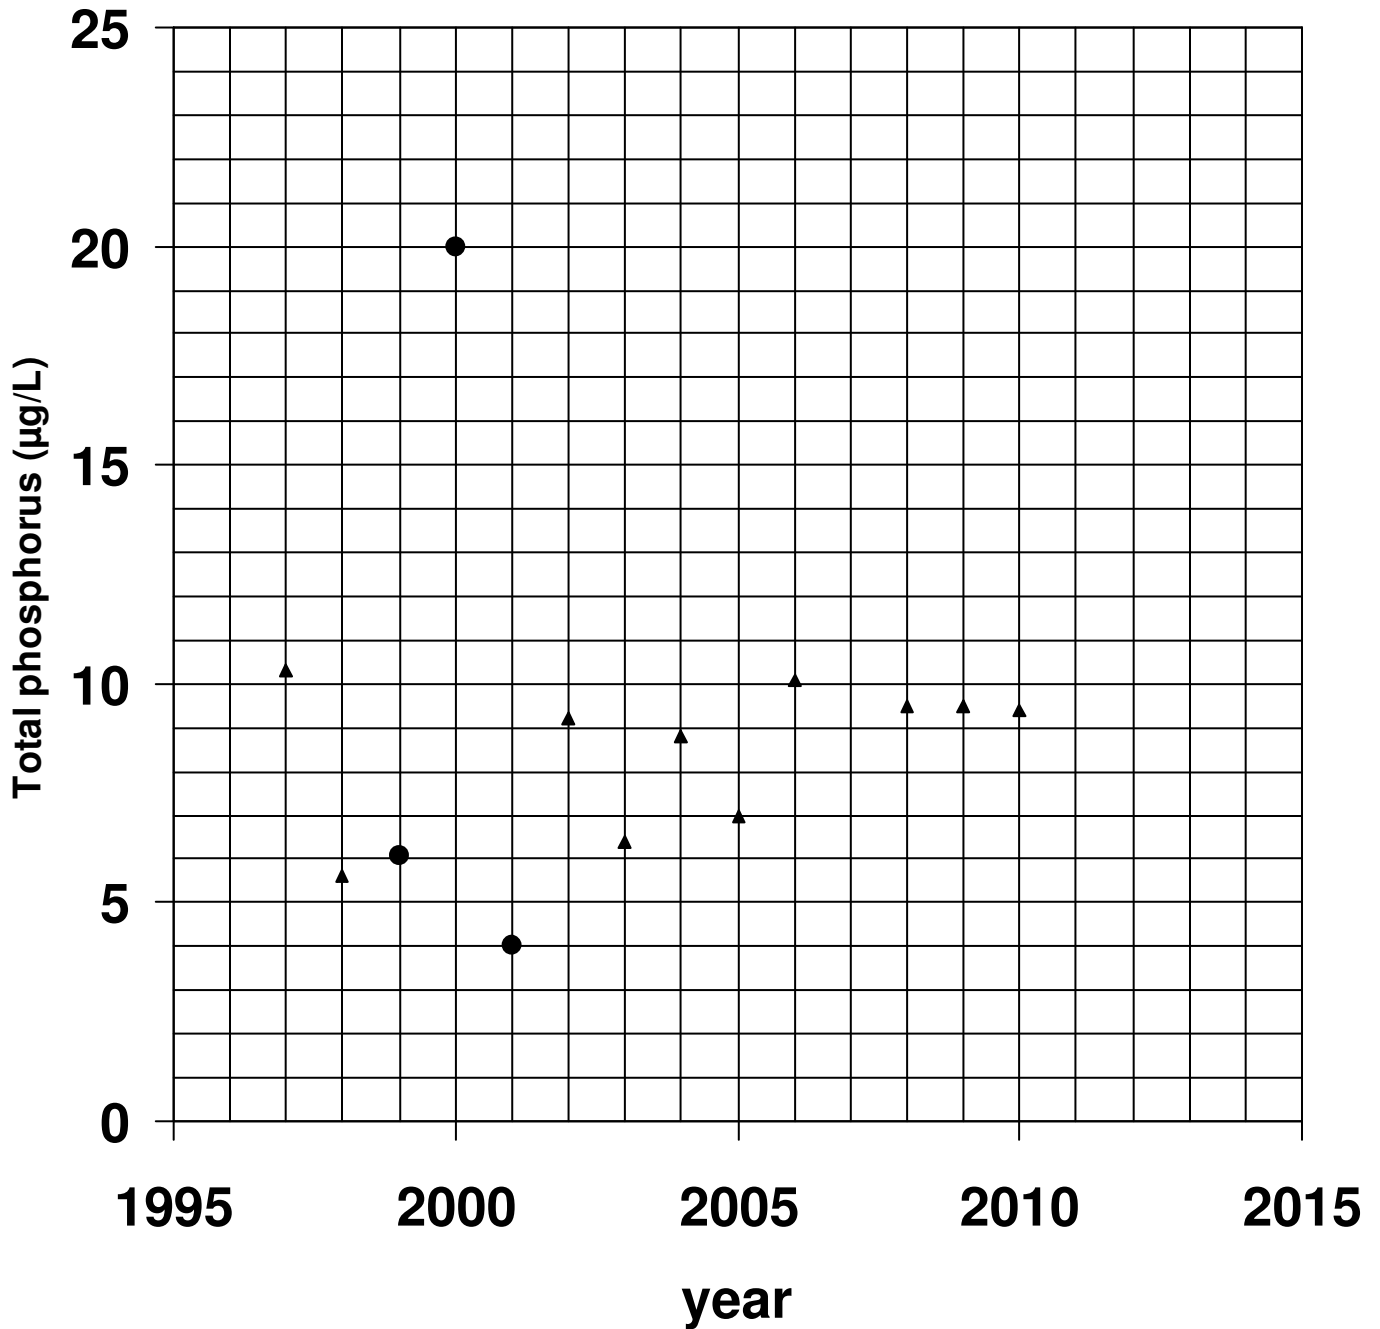

The circle data points (1999-2001) were from single samples.
The average phosphorus in 1971 was 16 µg/L.